

2404 2408

MODELS



Controller/Programmer Specification Sheet

- **High stability control**
- **Up to twenty programs**
- **16 segments**
- **Heating and cooling**
- **Customisable operation**
- **Heater current display**
- **Multiple alarms on a single output**
- **DC retransmission**
- **Digital communications**
 - **Modbus RTU**
 - **Profibus DP network**
 - **DeviceNet® network**

The 2404/2408 is a versatile, high stability temperature or process controller, with self and adaptive tuning, in 1/4 DIN and 1/8 DIN sizes. It comes with a standard 8 segment setpoint programmer, with options for one, four or twenty programs of 16 segments each.

It has a modular hardware construction which accommodates a wide range of plug-in modules. It will accept up to three I/O modules and two communication modules. Two digital inputs and an optional alarm relay are included as part of the fixed hardware build. The hardware is configurable for heating, cooling, alarms and other functions. A transmitter power supply option is available, as is a 5 or 10V transducer supply option. The 2404/2408 is fully configurable on-site.

The 16 segment programmer can have up to 8 programmable outputs which can be set in each segment to trigger external events. The two digital inputs can be used to run, hold and reset the program. Parallel operation of several programmers can be performed with synchronisation chosen at the end of any desired segments.

Precise control

An advanced PID control algorithm gives stable 'Straight-line' control of the process. A one-shot tuner is provided to set up the initial PID values and to calculate the overshoot inhibition parameters. In addition an adaptive tuner will handle processes with continually changing characteristics. On electrically heated loads, power feedback is used to stabilise the output power and hence the controlled temperature against supply voltage fluctuations. Dedicated cooling algorithms ensure optimum control of fan, water and oil cooled systems.

Universal input

A universal input circuit with an advanced analogue to digital convertor samples the input at 9Hz and continuously corrects it for drift. This gives high stability and rapid response to process changes. High noise immunity is achieved by rejection of 50/60Hz pick-up and other sources of noise. Sensor diagnostics are also provided. The input will accept all standard thermocouples, the Pt100 resistance thermometer and linear millivolts, milliamps or DC volts.

Customisable operation

A custom LED display provides a bright, clear display of the process value and setpoint. Tactile push buttons ensure positive operation. Dedicated buttons provide for auto/manual and program run/hold capabilities. Access to other parameters is simple and easy to understand and can be customised to present only those parameters that need to be viewed or adjusted. All other parameters are locked away under password protection.

Alarms

Up to four alarms can be combined onto a single output. They can be full scale high or low, deviation from setpoint, rate of change or load failure alarms. Alarm messages are flashed on the main display. Alarms can be configured as latching or non-latching and also as 'blocking' type alarms which means they will become active only after they have first entered a safe state.

Digital communications

2404/2408 controllers are available with a wide range of communications options. EIA485 2 wire, EIA232, EIA422 4 wire. Profibus DP or Eurotherm® proprietary PDS communications modules are available, offering Modbus RTU, Profibus DP (24xxf), DeviceNet, Eurotherm Bisynch or PDSIO protocols.

iTools configuration editor


Although 2404/2408 controllers are easily and fully configurable via the front panel, iTools configuration software offers an easy to use PC configuration tool.

iTools has the built-in ability to save or clone instrument configurations ensuring full back up of any engineering effort.



OPC Scope

OPC Scope is a separate utility that allows trending, data logging and Dynamic Data Exchange (DDE). It is an OPC explorer program that can connect to any OPC server that is in the Windows registry.

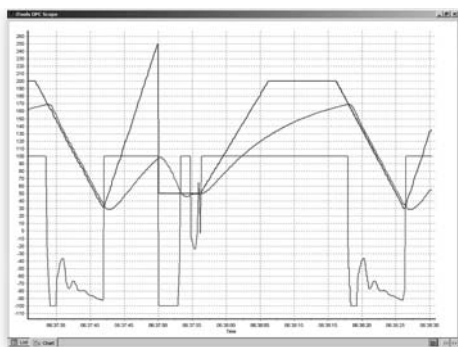

Both data logging and trending are available and the user can trend and view live data, with a scaleable time axis between 1 minute and 1 month. This utility also offers a Historical Review mode and data can be logged onto the PC hard disk, from which it may be retrieved and analysed in an Excel spreadsheet.

SPECIFICATION

General

Environmental performance

Temperature limits	Operation: 0 to 55°C Storage: -10 to 70°C
Humidity limits	Operation: 5 to 90% RH non condensing Storage: 5 to 90% RH non condensing
Panel sealing:	IP65
Altitude:	<2000 metres
Atmospheres:	Not suitable for use in explosive or corrosive atmosphere

Electromagnetic compatibility (EMC)

Emissions and immunity:	BS EN61326
-------------------------	------------

Suitable for domestic, commercial and light industrial as well as heavy industrial. (Domestic/light (Class B) emissions. Industrial environmental immunity.

Under industrial immunity conditions the instrument will not deviate by more than an additional amount equal to the published tolerance.

Electrical safety

BS EN61010	Installation cat. II; Pollution degree 2
------------	--

INSTALLATION CATEGORY II

The rated impulse voltage for equipment on nominal 230V mains is 2500V.

POLLUTION DEGREE 2

Normally, only non-conductive pollution occurs. Occasionally, however, a temporary conductivity caused by condensation shall be expected

Physical

Panel mounting	2408: 1/8 DIN 2404: 1/4 DIN
Weight	2408: 440g max. 2404: 670g max.
Panel cut-out dims.	2408: 45W x 92Hmm (-0.0 +0.8) 2404: 92W x 92Hmm (-0.0 +0.8)
Panel depth	Both: 148mm

Operator interface

Type:	Dual 7 segment LED up to 2 decimal places
Display	2408: Upper 12mm Lower 10mm 2404: Upper 21mm Lower 10mm
Status beacons:	OP1, OP2, SP2, REM
Status indicators:	Auto, manual, run, hold
Access levels:	Operator, full access, Edit, config. Password protected

Power requirements

Supply voltage:	85 to 264Vac, 48 to 62 Hz, 2404 16W max. 2408 13W max. 24Vac, -15%, +10% 24Vdc, -15% +20% ±5% ripple voltage
-----------------	---

Inrush current

High Voltage (VH):	30A duration <100µS
Low Voltage (VL):	15A duration <100µS

Approvals

CE, cUL listed (file E57766), Gost
Suitable for use in Nadcap and
AMS2750D applications under System
Accuracy Test calibration conditions

Communications

No of ports:	2 modules can be fitted
Slot allocation:	PDSIO remote setpoint or retransmission J comms port

Serial communications option

Protocols:	Modbus RTU Slave Profibus DP (24XXf only) EI-Bisynch (818 style mnemonics)
Isolation:	264Vac, double insulated
Transmission standard:	EIA232, EIA485, CAN (DeviceNet), Profibus (24XXf only)

Main process variable input

Calibration accuracy:	<±0.2% of reading ±1LSD
Sample rate:	9Hz (110ms)
Isolation:	264Vac double insulation
Input filter:	Off to 999.9. Default 1.6s
Zero offset:	User adjustable over full range
User calibration:	2-point gain & offset
Functions:	Includes process input, remote setpoint, power limit

Thermocouple

Range:	-100mV to +100mV
Types:	K, J, N, R, S, B, L, T, C, PL2, custom
Resolution (µV):	<3.3µV @ 1.6s filter time
Effective resolution:	15.9 bits
Linearisation accuracy:	<0.2% of reading
Cold junction compensation:	>30:1 rejection of ambient change External reference of 0°C, 45°C and 50°C <±1°C at 25°C ambient

Cold junction accuracy:

Resistance thermometer

Range:	0-400Ω (-200°C to +850°C)
Resistance thermometer types:	3-wire Pt100 DIN 43760
Resolution (°C):	<±0.08°C with 1.6sec filter
Effective resolution:	13.7 bits
Linearity error:	<0.033% (best fit straight line)
Calibration error:	<±0.4°C + 0.15% of reading in °C
Drift with temperature:	<±(0.015°C + 0.005% of reading in °C) per °C
Common mode rejection:	<0.00085°C/V (maximum of 264Vrms)
Series mode rejection:	<0.240°C/V (maximum of 280mV pk-pk)
Lead resistance:	0Ω to 22Ω, matched lead resistance
Input impedance:	100MΩ
Bulb current:	300µA

100mV range

Range:	-100mV to +100mV
Resolution (µV):	<3.3µV with 1.6s filter time
Effective resolution:	15.9 bits
Linearity error:	<0.033% (best fit straight line)
Calibration error:	<±10µV, ± 0.2% of measurement at 25°C
Drift with temperature:	<±0.2µV + 0.004% of reading per °C
Common mode rejection:	>146dB (maximum of 264Vrms)
Series mode rejection:	>90dB (maximum of 280mV pk-pk)
Input impedance:	>100MΩ

10 Volts range

Range:	0V to +10.0V
Resolution (µV):	<300µV with 1.6sec filter
Effective resolution:	15.4 bits
Linearity error:	<0.033% (best fit straight line)
Calibration error:	<±(0.4°C + 0.15% of reading in °C)
Drift with temperature:	<± 0.1mV + 0.02% of reading per °C
Common mode rejection:	>145dB (maximum of 264Vrms)
Series mode rejection:	>92dB (maximum of 5V pk-pk)
Input impedance:	>69kΩ

Notes

- (1) Calibration accuracy quoted over full ambient operating range and for all input linearisation types
- (2) Contact Eurotherm for details of availability of custom downloads for alternative sensors

Digital input (LA and LB)

Isolation:	Not isolated from each other. 264Vac double insulation from the PSU and communication
------------	---

Input

Rating	Voltage level: Closed 0 to <11Vdc Open >13 to 24Vdc
	Contact closure: Open >28kΩ Closed <100Ω
Functions:	Includes program control, alarm acknowledge, SP2 select, manual, keylock, RSP select, standby

AA Relay

Type:	Form C (changeover)
Rating:	Min 1mA @ 1Vdc, Max 2A @ 264Vac resistive 1,000,000 operations with external snubber
Isolation:	264Vac double insulation
Functions:	Alarms, events, status

DC Input module (Isolated)

Calibration accuracy:	<±0.2% of reading ±1LSD
Sample rate:	9Hz (110ms)
Isolation:	264Vac double insulation
Input filter:	Off to 999.9. Default 1.6s
Zero offset:	User adjustable over full range
User calibration:	2-point gain & offset
Functions:	Includes process input, remote setpoint, power limit

Thermocouple

Range:	-100mV to +100mV
Types:	K, J, N, R, S, B, L, T, C, PL2, custom
Resolution (µV):	<3.3µV @ 1.6s filter time
Effective resolution:	15.9 bits
Linearisation accuracy:	<0.2% of reading
Cold junction compensation:	>30:1 rejection of ambient change External reference of 0°C, 45°C and 50°C <±1°C at 25°C ambient

Cold junction accuracy:

Resistance thermometer

Range:	0-400Ω (-200°C to +850°C)
Resistance thermometer types:	3-wire Pt100 DIN 43760
Resolution (°C):	<±0.08°C with 1.6sec filter
Effective resolution:	13.7 bits
Linearity error:	<0.033% (best fit straight line)
Calibration error:	<±0.4°C + 0.15% of reading in °C
Drift with temperature:	<±(0.015°C + 0.005% of reading in °C) per °C
Common mode rejection:	<0.00085°C/V (maximum of 264Vrms)
Series mode rejection:	<0.240°C/V (maximum of 280mV pk-pk)
Lead resistance:	0Ω to 22Ω, matched lead resistance
Input impedance:	100MΩ
Bulb current:	300µA

100mV range

Range:	-100mV to +100mV
Resolution (µV):	<3.3µV with 1.6s filter time
Effective resolution:	15.9 bits
Linearity error:	<0.033% (best fit straight line)
Calibration error:	<±10µV, ± 0.2% of measurement at 25°C
Drift with temperature:	<±0.2µV + 0.004% of reading per °C
Common mode rejection:	>146dB (maximum of 264Vrms)
Series mode rejection:	>90dB (maximum of 280mV pk-pk)
Input impedance:	>100MΩ

10 Volts range

Range:	-3.0V to +10.0V
Resolution (µV):	<300µV with 1.6sec filter
Effective resolution:	15.4 bits
Linearity error:	<0.033% (best fit straight line)
Calibration error:	<±(0.4°C + 0.15% of reading in °C)
Drift with temperature:	<± 0.1mV + 0.02% of reading per °C
Common mode rejection:	>145dB (maximum of 264Vrms)
Series mode rejection:	>92dB (maximum of 5V pk-pk)
Input impedance:	>69kΩ

Potentiometer input

Type:	Single channel
Resistance:	100Ω to 15kΩ
Excitation:	0.5Vdc supplied by module
Isolation:	264Vac double insulation
Functions:	Includes valve position and remote setpoint

Analogue control output

Type:	Single channel
Rating:	0-20mA <600Ω 0-10Vdc >500Ω
Accuracy:	±2.5%
Resolution:	10 bits
Isolation:	264Vac double insulation

Analogue retransmission output

Type:	Single channel
Rating:	0-20mA <600Ω 0-10Vdc >500Ω
Accuracy:	±0.5%
Resolution:	11 bits
Isolation:	264Vac double insulation

Logic input modules

Module types:	Triple contact closure, triple logic level
Isolation:	No channel isolation. 264Vac double insulation from other modules and system
Rating:	Voltage Level: Open -3 to 5Vdc @ <-0.4mA Closed 10.8 to 30Vdc @ 2.5mA
Contact closure:	Open >28kΩ Closed <100Ω
Functions:	Includes program control, alarm acknowledge, SP2 select, manual, keylock, RSP select, standby

Logic output modules

Module types:	Single channel, triple channel
Isolation:	No channel isolation. 264Vac double insulation from other modules and system
Rating	Single: 12Vdc @ 24mA, source Triple: 12Vdc @ 9mA, source
Functions:	Includes control outputs, alarms, events, status

Relay modules

Module types:	Single channel Form A, Single channel Form C, dual channel Form A
Isolation:	264Vac double insulation
Rating:	Min 100mA @ 12Vdc, Max 2A @ 264Vac resistive Min 400,000 (max load) operations with external snubber
Functions:	Includes control outputs, alarms, events, status

Triac modules

Module types:	Single channel, dual channel
Isolation:	264Vac double insulation
Rating:	<1A @ 30-264Vac resistive
Functions:	Includes control outputs, alarms, events, status

Transmitter PSU module

Type:	Single channel
Isolation:	264Vac double insulation
Rating:	24Vdc @ 20mA


Transducer PSU module

Type:	Single channel
Isolation:	264Vac double insulation
Bridge voltage:	Software selectable 5Vdc or 10Vdc
Bridge resistance:	300Ω to 15kΩ
Internal shunt resistor:	30.1Ω @0.25%, used for calibration of 350Ω bridge at 80%

Software features

Control loop	
Control types:	PID, OnOff, VP, Dual VP
Cooling types:	Linear, fan, oil, water
Modes:	Auto, manual, forced manual
Overshoot inhibition:	High and low cutbacks
Number of PID sets:	2, selectable on PV
Control options:	Supply voltage compensation, feedforward, output tracking, OP power limiting, SBR safe output
Setpoint options:	Remote SP with trim, SP rate limit, 2nd Setpoint, tracking modes
Setpoint programmer	
Program function:	Standard 1, 8 segment Optional 1, 4 or 20, 16 segment 8 with 16 segment programmer
Events:	Ramp rate, Ramp time, dwell, call, step
Segment types:	Run, Hold, Reset, RunHold, RunReset, ResetRun, Adv Seg, Skip Seg
Digital inputs:	Process value, setpoint
Servo action:	Continue, ramp, reset
Power failure modes:	Holdback, inputs
Other functions:	
Process alarms	
Number:	4
Type:	High, low, devhi, devlo, devband
Latching:	None, auto, manual, event
Other features:	Blocking


Isolation diagram

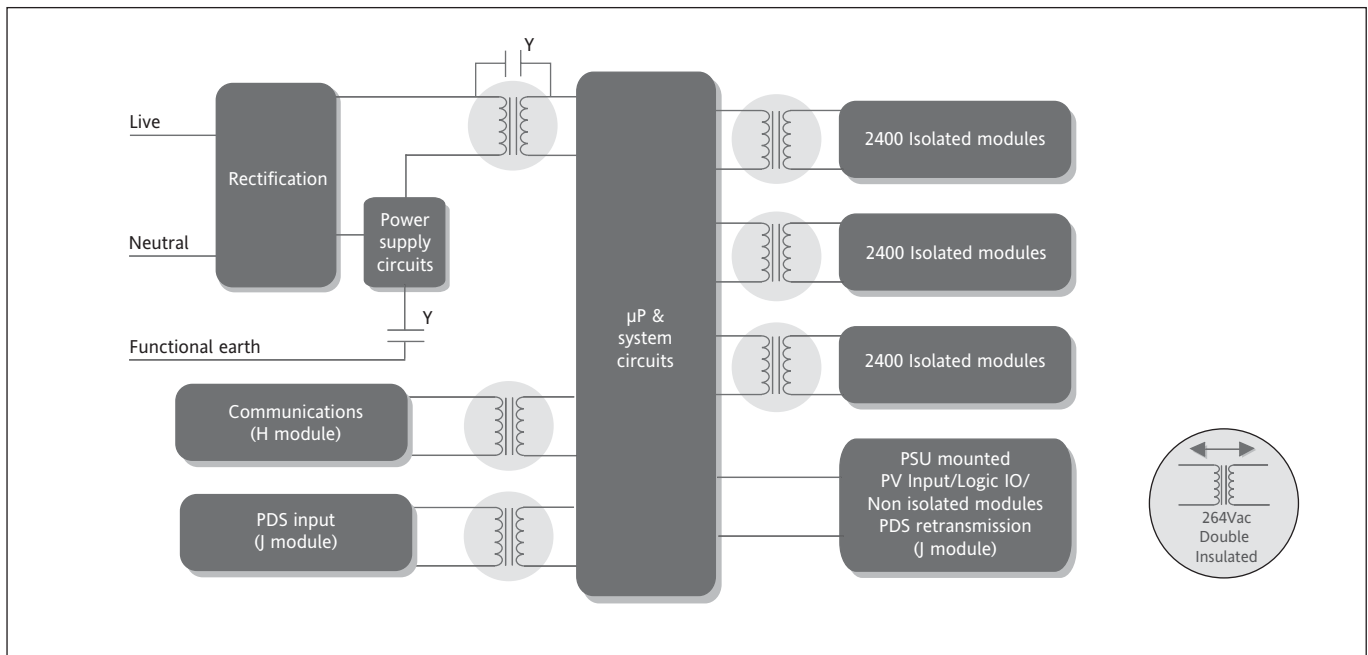

PDSIO load diagnostics

PDSIO (Pulse Density Signalling I/O) is a major innovation in the 2404/2408. When used in combination with a Eurotherm TE10 solid state relay (SSR), it allows the logic output of a 2404/2408 to transmit the power demand signal and simultaneously read back load fault alarms. These alarms will be flashed as messages on the controller front panel.


Two alarm conditions will be detected, either SSR failure indicating an open or short circuit condition in the SSR and heater circuit failure indicating either fuse failure, heater open circuit or line supply absent.

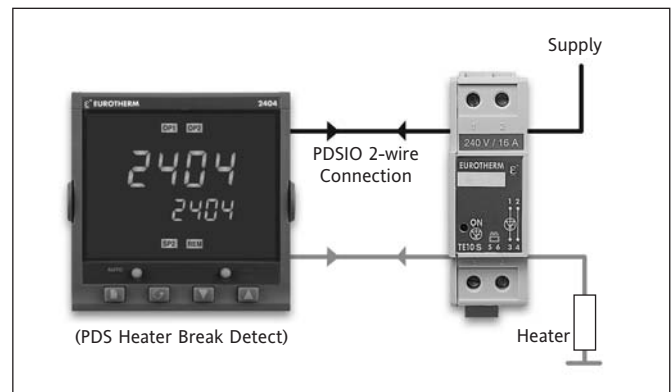

PDSIO master setpoint transmission


PDSIO can be used to digitally transmit the setpoint profile to a number of slave Series 2000 controllers.

If any slave zone departs from the required setpoint by more than a pre-settable amount, a signal from any slave can be transmitted back to the master causing the program to freeze until the error is corrected. Digital accuracy is preserved using PDSIO.


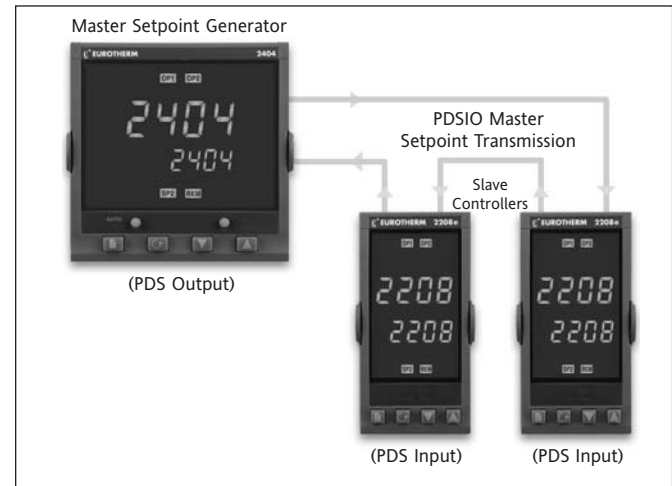


Rear terminal connections

2408

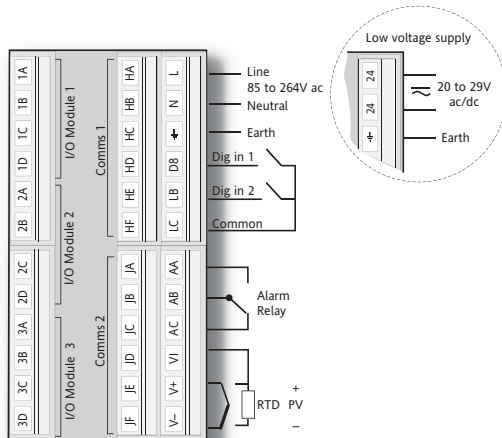

2404

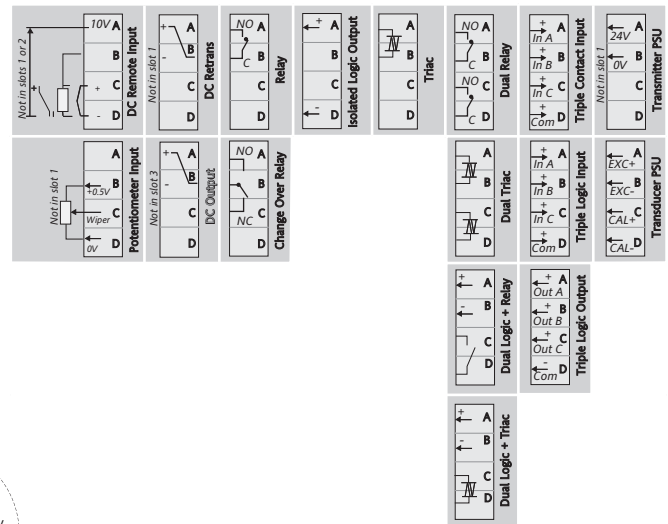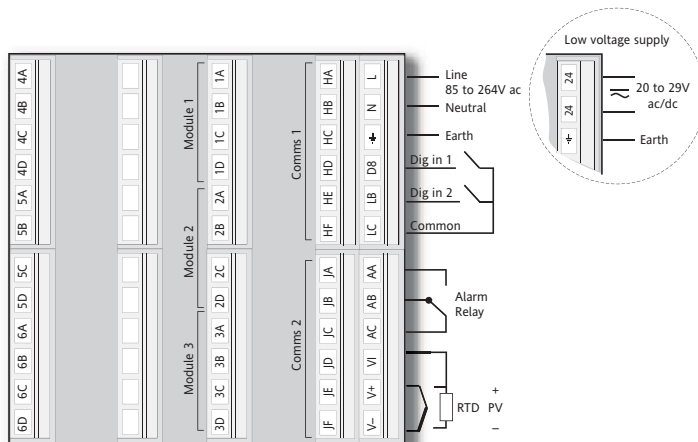

Hardware coding

2408
2404

Model Number	Function	Supply Voltage	Module 1	Module 2	Module 3	Alarm Relay	10amp Output	Comms 1	Comms 2	Manual
							Omit for 2408			

Model Number	Module 1	Module 2	Module 3	10amp Output
Panel size 2408 48x96mm 2404 96x96mm Profibus units 2408f 48x96mm 2404f 96x96mm	XX Not fitted Relay: 2-pin R2 Fitted unconfigured RH Heating output RU Valve raise output Relay: change over R4 Fitted unconfigured YH Heating output RP Valve raise (note 6) <i>Or alarm 1 from table A</i> Logic: (Non-isolated) L2 Fitted unconfigured LH Heating output M1 PDS Heater break detect (note 2) M2 PDS Current monitoring (note 3) Logic: (Isolated) LO Single logic OP Triac T2 Fitted unconfigured TH Heating output TU Valve raise output DC control (Isolated) D4 Fitted unconfigured H6 0-20mA heating H7 4-20mA heating H8 0-5V heating H9 1-5V heating HZ 0-10V heating Digital I/O (unconfig'd) TK Triple contact input TL Triple logic input TP Triple logic output Dual relay RR Fitted unconfigured RD Heat + cool RM VP raise & lower OPs Dual triac TT Fitted unconfigured TD Heat + cool TM VP raise & lower OPs Logic+relay LR Fitted unconfigured LD Heat + cool QC Mode 2 + cool Logic+triac LT Fitted unconfigured GD Heat & cool QD Mode 2 + cool Transducer PS G3 5Vdc transducer PSU G5 10Vdc transducer PSU Table A: alarm codes FH High alarm FL Low alarm DB Dev. band alarm DL Dev. low alarm DH Dev. high alarm	XX Not fitted Relay: 2-pin R2 Fitted unconfigured RC Cooling output RW Valve lower output Relay: change over R4 Fitted unconfigured YC Cooling output RL Valve lower(note 6) PO Program event 1 (note 7) PE Program END output <i>Or alarm 2 from table A</i> Dual relay RR Fitted unconfigured PP Program events 1 & 2 (note 7) Logic: (Non-isolated) L2 Fitted unconfigured LC Cooling output Logic: (Isolated) LO Single logic OP Triac T2 Fitted unconfigured TC Cooling output TW Valve lower output DC control (Isolated) D4 Fitted unconfigured C6 0-20mA cooling C7 4-20mA cooling C8 0-5V cooling C9 1-5V cooling CZ 0-10V cooling Digital I/O (unconfig'd) TK Triple contact input TL Triple logic input TP Triple logic output Power supply MS 24Vdc transmitter DC retrans. (Isolated) <i>Select from Table B</i> Potentiometer input VU Fitted unconfigured VS Valve position feedback VR Setpoint input Table B: DC retransmission D6 Fitted unconfigured First character V- PV retrans S- Setpoint retrans O- Output retrans Z- Error retrans Second character -1 0-20mA -2 4-20mA -3 0-5V -4 1-5V -5 0-10V	XX Not fitted Relay: 2-pin R2 Fitted unconfigured Relay: change over R4 Fitted unconfigured PO Program event 4 (note 7) PE Program END output <i>Or alarm 3 from table A</i> Logic: (Non-isolated) L2 Fitted unconfigured Logic: (Isolated) LO Single logic OP Triac T2 Fitted unconfigured Dual relay RR Fitted unconfigured PP Program event 4 & 5 (note 7) Digital I/O (unconfig'd) TK Triple contact input TL Triple logic input TP Triple logic output Power supply MS 24Vdc transmitter DC remote input D5 Fitted unconfigured W2 4-20mA setpoint W5 0-10V setpoint WP Second PV input DC retrans. (Isolated) <i>Select from Table B</i> Potentiometer input VU Fitted unconfigured VS Valve position feedback VR Setpoint input	XX Not fitted
Function (2408)	Function (2404)	Alarm relay	Comms 1	Comms 2
PID control CC Controller only CG 1x 8 seg Prog CP 1x16 seg Prog P4 4x16 seg Prog CM 20x16 seg Prog (note 1) On/Off Control NF Controller only NG 1x8 seg Prog NP 1x16 seg Prog N4 4x16 seg Prog NM 20x16 seg Prog (note 1) Motorised valve control VC Valve positioner VG 1x8 seg Prog VP 1x16 seg Prog V4 4x16 seg Prog VM 20x16 seg Prog (note 1)	PID control CC Controller only CG 1x 8 seg Prog CP 1x16 seg Prog P4 4x16 seg Prog CM 20x16 seg Prog (note 1) On/Off Control NF Controller only NG 1x8 seg Prog NP 1x16 seg Prog N4 4x16 seg Prog NM 20x16 seg Prog (note 1) Motorised valve control VC Valve positioner VG 1x 8 seg Prog VP 1x16 seg Prog V4 4x16 seg Prog VM 20x16 seg Prog (note 1)	XX Not fitted Alarm 4 relay RF Fitted unconfigured <i>Table A alarm options plus:</i> RA Rate of change alarm <i>PDS Alarms</i> LF Heater break detect HF Current monitoring heater break SF Current monitoring SSR failure PO Program event 7 (note 7) PE Program END output	XX Not fitted 2 wire, EIA485 Y2 Fitted unconfigured YM Modbus protocol YE El-Bisynch protocol (note 1) EIA232 A2 Fitted unconfigured AM Modbus protocol AE El-Bisynch protocol (note 1) 4 wire EIA422 F2 Fitted unconfigured FM Modbus protocol FE El-Bisynch protocol (note 1) PDS Output M7 Fitted unconfigured PT PV retrans TS Setpoint retrans OT Output retrans Profibus Module PB Profibus (note 6) DeviceNet DN DeviceNet	XX Not fitted
Supply Voltage	Manual			
VH 85-264Vac VL 20-29Vac/dc	XXXX No manual ENG English FRA French GER German NED Dutch SPA Spanish SWE Swedish ITA Italian			

2404/2408 Accessories

Handbook	HA025132
Communications handbook	HA026230
Profibus DP handbook	HA026290
2.49Ω precision resistor	SUB24/2R49.1

Sensor Input	Setpoint Min	Setpoint Max	Display Units	Digital Input 1	Digital Input 2	Control	Power	Options Cooling	Buttons	Program
	note 4	note 4								

Sensor Input	Setpoint Min	Setpoint Max
Standard Sensor Inputs	Min	*C Max
J J Thermocouple	-210	1200
K K Thermocouple	-200	1372
T T Thermocouple	-200	400
L L Thermocouple	-200	900
N N Thermocouple-Nicrosil/Nisil	-250	1300
R R Thermocouple-Pt/Pt13%Rh	-50	1700
S S Thermocouple-Pt/Pt10%Rh	-50	1768
B B Thermocouple-Pt/Pt30%Rh -6%Rh	0	1820
P Platinel II Thermocouple	0	1369
Z RTD/PT100 DIN 43760	-200	850
Factory Downloaded Input	Min	*C Max
C C Thermocouple - W5%Re/W26%Re (Hoskins)	0	2319
D D Thermocouple - W3%Re/W25%Re	0	2399
E E Thermocouple	-250	1000
1 Ni/Ni18%Mo Thermocouple	0	1399
2 Pt20%Rh/Pt40%Rh Thermocouple	0	1870
3 W/W26%Re (Engelhard) Thermocouple	0	2000
4 W/W26%Re (Hoskins) Thermocouple	0	2010
5 W5%Re/W26%Re (Engelhard) Thermocouple	10	2300
6 W5%Re/W26%Re (Bucose) Thermocouple	0	2000
7 Pt10%Rh/Pt40%Rh Thermocouple	200	1800
8 Exergen K80 I.R. pyrometer	-45	650
Process Inputs (Scaled to setpoint min and max)	Min	*C Max
F -100 to +100mV linear	-1999	9999
Y 0 to 20mA linear (note 4)	-1999	9999
A 4 to 20mA linear (note 4)	-1999	9999
W 0 to 5Vdc linear	-1999	9999
G 1 to 5Vdc linear	-1999	9999
V 0 to 10Vdc linear	-1999	9999

Display Units
C Celsius
F Fahrenheit
K Kelvin
X Linear input

Digital Input 1 & 2
XX Disabled
AM Manual select
SR Remote SP select
S2 Second setpoint
EH Integral hold
AC Alarm acknowledge
RP SP rate limit enabled
RN Run program
HO Hold program
RE Reset program
RH Run/hold prog
KL Keylock
NT Run/Reset
TN Reset/Run
HB Program holdback
P2 Second PID
ST One shot tune enable
AT Adaptive tune enable
FA Select full access level
RB Simulates UP button
LB Simulates DOWN button
SB Simulates SCROLL button
PB Simulates PAGE button
B1 Least sig. BCD digit
B2 2nd BCD digit
B3 3rd BCD digit
B4 4th BCD digit
B5 5th BCD digit
B6 Most significant digit
SY Standby-all O/Ps OFF
SC Prog synchronisation
SG Skip segment (without changing SP)
PV Select PV2
AG Advance to end of segment(& step to target SP)
M5 CTX (mode 5) Input 2 only

Options
Control action
XX Reverse acting (standard)
DP Direct acting
Power feedback
XX Enabled on logic, relay & triac heating
PD Feedback disabled
Cooling options
XX Linear cooling
CF Fan cooling
CW Water cooling
CL Oil cooling
NT On/Off cooling
CO On/Off cooling
Front panel buttons
XX Enabled
MD Auto/manual disabled
MR Auto/man & run/hold disabled
RD Run/hold disabled
Programmer time units
XX Dwell & ramp in mins
HD Dwell time in hours
HR Ramp rate in units/hrs
HT Ramp/dwell hours

Note 1.
Not available with profibus controllers

Note 2.
PDS heater break detect will transmit the power demand to a TE10S Solid State Relay and read back a heater break alarm.

Note 3.
PDS current monitoring will transmit the power demand signal to a TE10S Solid State Relay and read back load current and open and short circuit alarms.

Note 4.
Setpoint limits: Include the decimal position required in the displayed value. Up to one for temperature inputs, up to two for process inputs.

Note 5.
An external 1% current sense resistor is supplied as standard. If greater accuracy is required, a 0.1% 2.49Ω can be ordered as part no. SUB2K/249R.1.

Note 6.
Only available with Profibus controller.






Note 7.
Not available with 8 segment programmer

Example ordering code

2408 - CC - VH - LH - RC - FL - FH - YM - TS - K - 0 - 1000 - C - AM - S2 - XX - XX - XX - MD - XX

2408, PID Controller, 85 to 264Vac, Logic heating, Relay cooling, Low alarm relay, High alarm relay, RS485, Modbus comms, PDSIO setpoint retrans, Type K thermocouple, 0 to 1000°C, Auto/manual select, 2nd setpoint select, Manual button disabled.

Dimensional details

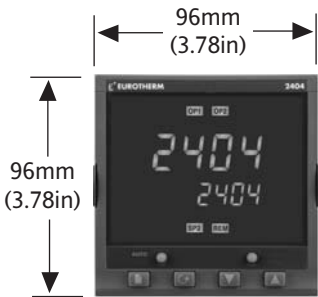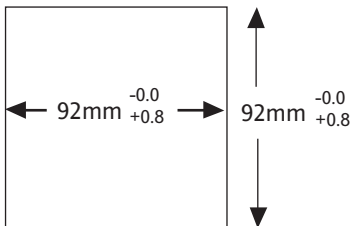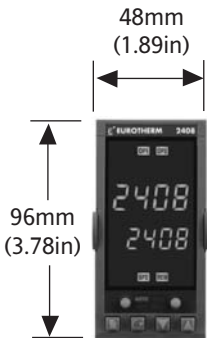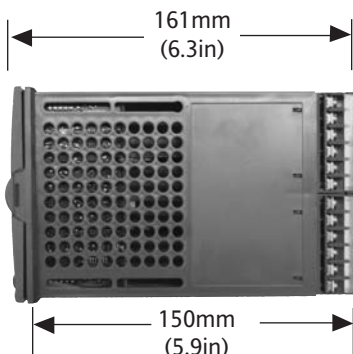2404	2408	2404/08
 <p>96mm (3.78in)</p> <p>96mm (3.78in)</p> <p>Panel cut-out</p>  <p>92mm^{-0.0/+0.8}</p> <p>92mm^{-0.0/+0.8}</p>	 <p>48mm (1.89in)</p> <p>96mm (3.78in)</p>  <p>45mm^{-0.0/+0.6}</p> <p>92mm^{-0.0/+0.8}</p>	 <p>161mm (6.3in)</p> <p>150mm (5.9in)</p>

Eurotherm: International sales and service

Understanding and providing local support is a key part of Eurotherm's business. Complementing worldwide Eurotherm offices are a whole range of partners and a comprehensive technical support team... to ensure you get a service you will want to go back to.

AUSTRALIA Sydney
Eurotherm Pty. Ltd.
T (+61 2) 9838 0099
F (+61 2) 9838 9288
E info.au@eurotherm.com

AUSTRIA Vienna
Eurotherm GmbH
T (+43 1) 7987601
F (+43 1) 7987605
E info.at@eurotherm.com

BELGIUM & LUXEMBOURG Mola
Eurotherm S.A./N.V.
T (+32) 85 274080
F (+32) 85 274081
E info.be@eurotherm.com

BRAZIL Campinas-SP
Eurotherm Ltda.
T (+5519) 3707 5333
F (+5519) 3707 5345
E info.br@eurotherm.com

DENMARK Copenhagen
Eurotherm Danmark AS
T (+45 70) 234670
F (+45 70) 234660
E info.dk@eurotherm.com

FINLAND Abo
Eurotherm Finland
T (+358) 22506030
F (+358) 22503201
E info.fi@eurotherm.com

FRANCE Lyon
Eurotherm Automation SA
T (+33 478) 664500
F (+33 478) 352490
E info.fr@eurotherm.com

GERMANY Limburg
Eurotherm Deutschland GmbH
T (+49 6431) 2980
F (+49 6431) 298119
E info.de@eurotherm.com

HONG KONG & CHINA
Eurotherm Limited North Point
T (+85 2) 28733826
F (+85 2) 28700148
E info.hk@eurotherm.com

Guangzhou Office
T (+86 20) 8755 5099
F (+86 20) 8755 5831
E info.cn@eurotherm.com

Beijing Office
T (+86 10) 6567 8506
F (+86 10) 6567 8509
E info.cn@eurotherm.com

Shanghai Office
T (+86 21) 6145 1188
F (+86 21) 6145 1187
E info.cn@eurotherm.com

INDIA Chennai
Eurotherm India Limited
T (+91 44) 24961129
F (+91 44) 24961831
E info.in@eurotherm.com

IRELAND Dublin
Eurotherm Ireland Limited
T (+353 1) 4691800
F (+353 1) 4691300
E info.ie@eurotherm.com

ITALY Como
Eurotherm S.r.l.
T (+39 31) 975111
F (+39 31) 977512
E info.it@eurotherm.com

KOREA Seoul
Eurotherm Korea Limited
T (+82 31) 2738507
F (+82 31) 2738508
E info.kr@eurotherm.com

NETHERLANDS Alphen a/d Rijn
Eurotherm B.V.
T (+31 172) 411752
F (+31 172) 417260
E info.nl@eurotherm.com

NORWAY Oslo
Eurotherm A/S
T (+47 67) 592170
F (+47 67) 118301
E info.no@eurotherm.com

POLAND Katowice
Invensys Eurotherm Sp z o.o.
T (+48 32) 2185100
F (+48 32) 2177171
E info.pl@eurotherm.com

SPAIN Madrid
Eurotherm España SA
T (+34 91) 6616001
F (+34 91) 6619093
E info.es@eurotherm.com

SWEDEN Malmo
Eurotherm AB
T (+46 40) 384500
F (+46 40) 384545
E info.se@eurotherm.com

SWITZERLAND Wollerau
Eurotherm Produkte (Schweiz) AG
T (+41 44) 7871040
F (+41 44) 7871044
E info.ch@eurotherm.com

UNITED KINGDOM Worthing
Eurotherm Limited
T (+44 1903) 268500
F (+44 1903) 265982
E info.uk@eurotherm.com
www.eurotherm.co.uk

U.S.A. Leesburg VA
Eurotherm Inc.
T (+1 703) 443 0000
F (+1 703) 669 1300
E info.us@eurotherm.com
www.eurotherm.com

ED53

Martech Controls
2000 Teall Avenue
Syracuse, NY 13026
Tel: (315) 876-9120
www.martechcontrols.com
sales@martechcontrols.com

