

2408i

MODEL



Model 2408i
1/8 DIN (96 x 48mm)

Universal Indicator and Alarm Unit

Ideal for:

- Temperature indication
- Pressure, flow and level monitoring
- Differential measurement
- Data acquisition and transmission
- Process protection
- Weighing platforms
- Strain gauge inputs
- Melt pressure indication

Features:

- Four alarm setpoints
- Custom linearisation
- Digital communications
- DC retransmission
- Remote setpoint input
- INSTANT ACCURACY™
- Alarm functions
- Auto calibration tare function
- Plug-in from front
- Three year warranty

Accurate, stable measurement of temperature, pressure, level, flow and other process variables are provided by the 2408i universal indicator. An optional second process value input allows the average, difference, minimum or maximum of two values to be displayed. Large, bright, red or green displays ensure good visibility in high and low ambient lighting.

Temperature inputs

Temperature can be displayed in Celsius, Fahrenheit or Kelvin. Nine internally stored thermocouple types and the Pt100 resistance thermometer are selectable. Other input linearisations can be factory downloaded.

Pressure inputs

4-20mA transmitter inputs can be powered from an internal 24Vdc supply.

Direct pressure sensor and strain gauge inputs can be energised from an internal 5 or 10Vdc supply. An automatic calibration routine is provided to remove zero and span offsets.

Flow inputs

For flow measurements, square root extraction is available as standard.

Level measurement

Liquid volume in a tank can be derived from a level measurement using an in-built 15-point linearisation curve. The level vs volume measurement is linear up the straight sides of the tank but nonlinear round the curved bottom. The 15-point fit can be applied to any part of the input signal to give an accurate displayed value.

For operator alert and plant protection

15 point custom table for specialised sensors

With Modbus®, ASCII and Profibus-DP protocol for DeviceNet supervisory control and data logging

Fully isolated trouble-free retransmission to remote control and monitoring equipment

To which deviation alarms can be applied.

Cold junction sensing technology eliminates warm-up errors

Selectable on PV1, PV2 and main PV inputs

Weighing platform/strain gauge inputs may be easily calibrated prior to measurement. Ref HA027223 for further information.

For rapid replacement - reducing downtime

Low ownership cost



EUROTHERM

CONTROLS
DATA MANAGEMENT
PROCESS AUTOMATION


Alarms in the 2408i

Alarm messages are flashed in the main display and beacons flash for a new alarm and go steady when acknowledged. **AL1**


Four configurable soft alarms can be individually assigned to either of two process value inputs.

FULL SCALE ALARMS

FULL SCALE HIGH

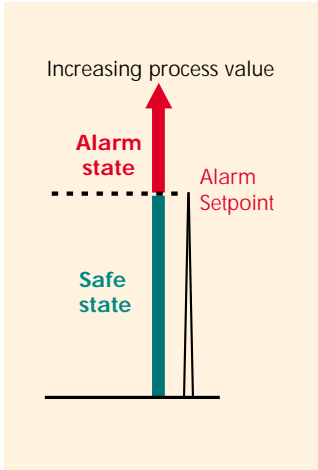


FULL SCALE LOW

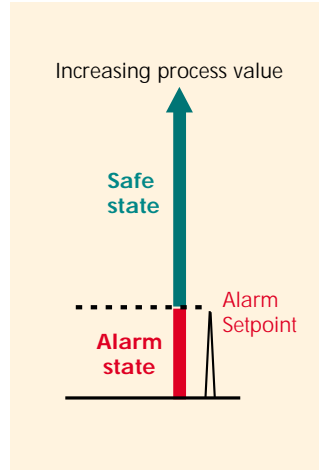


RATE-OF-CHANGE ALARMS

RATE OF INCREASE

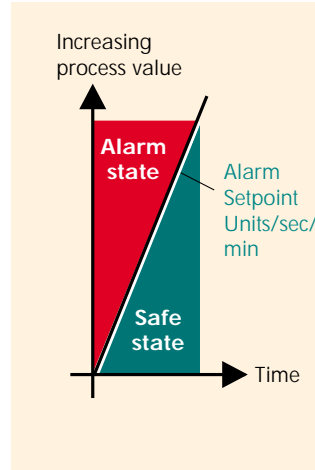


RATE OF DECREASE

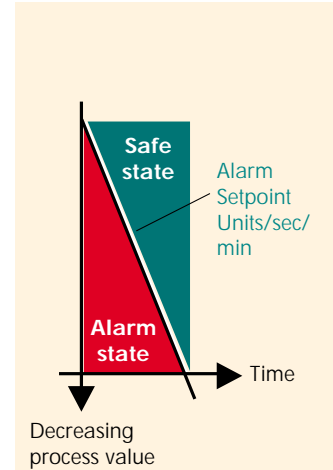


DEVIATION FROM SETPOINT ALARMS


DEVIATION HIGH

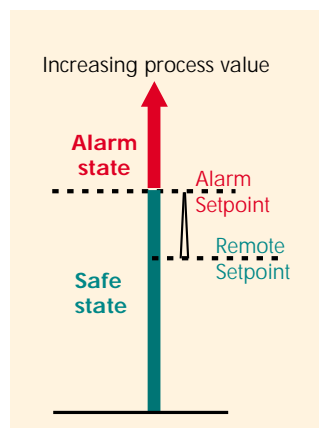

DEVIATION LOW

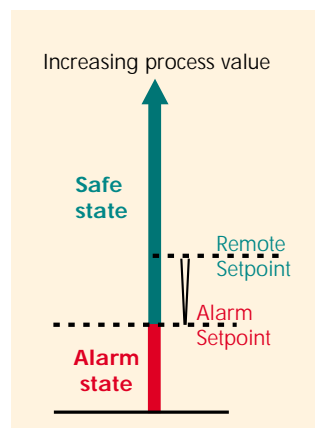

DEVIATION BAND

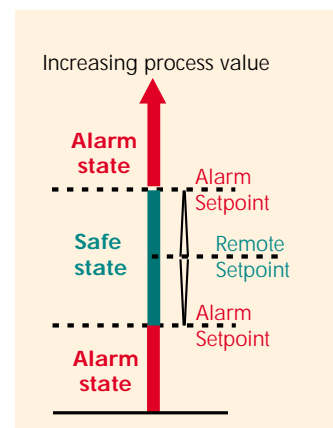


Deviation alarms

Deviation alarms operate on the difference between the process value and a remote setpoint input. The setpoint input is normally the retransmitted setpoint output of the product temperature controller. An alarm will be generated if the process value deviates from the setpoint by more than a preset amount. This facility is particularly useful to protect high value product against excess temperature.

Alarm modes


Latching or non-latching operation can be selected and alarm delays can be applied. A special mode known as 'alarm blocking' is available. In this mode, after power on the alarm must first enter a safe state before the alarms will become active. This is particularly useful for low alarms which can be 'blocked' while the process is warming-up.

Up to four alarms can be combined on to one output:

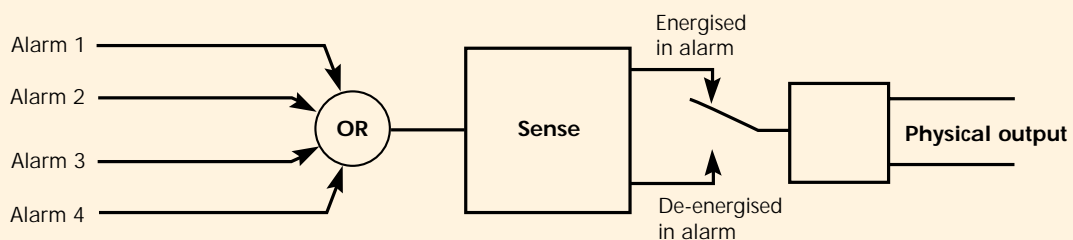


Combining alarms on to an output


Electrical Connections

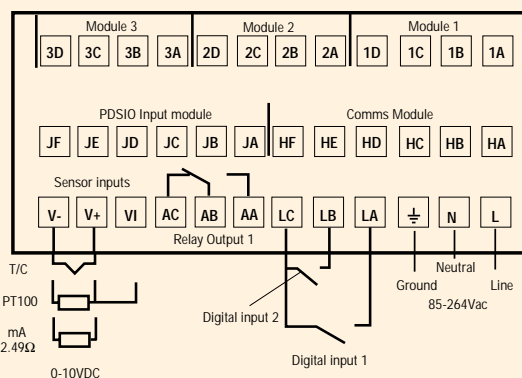

The 2408i has a modular hardware build which accepts a wide range of plug-in I/O modules - see the ordering code for module types available.

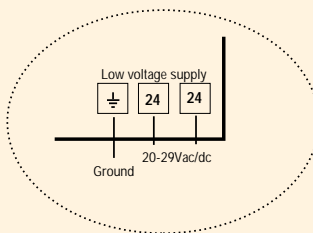

Dimensional details

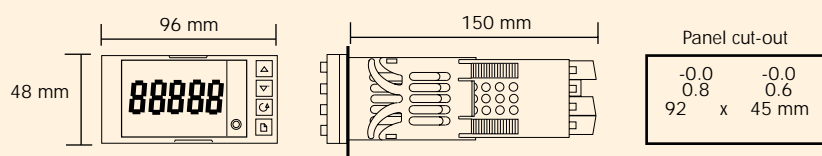

Technical Specification

All inputs and outputs are isolated unless otherwise stated

Main process value input and second DC input

| | |
|------------------------------|---|
| Low level range | -100 to +100mV |
| High level range | 0-20mA or 0-10Vdc |
| Sample rate | 9Hz |
| Resolution | <2μV for low level inputs <0.2mV for high level inputs |
| Linearity | Better than 0.2°C |
| Calibration accuracy | ±0.2% of reading, or ±1°C or ±1LSD, whichever is the greater |
| User calibration | Low and high offsets can be applied |
| Input filtering | OFF to 999.9 seconds |
| Thermocouple types | Refer to the ordering code sensor input table |
| Cold Junction compensation | In automatic mode, >30 to 1 rejection of ambient temperature change OR external 0°C, 45°C, 50°C external references |
| 3-wire Pt100 input | Bulb current: 0.3mA. Up to 22ohm in each lead without error |
| 2nd analogue input functions | 2nd process value, remote setpoint, select min, select max, derived value |
| Custom curve | 15 point, user selectable |

Digital inputs

Contact closure or open collector inputs

| | |
|---|---|
| Note: these are powered by the controller | |
| Digital inputs 1 & 2 (Non isolated from PV) | Switching voltage/current: 24Vdc/20mA nominal Off state resistance < 100ohms On state resistance > 28Kohm Specification is as per digital inputs 1 & 2 |
| Triple contact closure inputs (isolated) | |

Externally powered inputs

| | |
|---------------------|---|
| Triple logic inputs | Off state: <5Vdc On state: 10.8 to 30Vdc @ 2.5mA |
|---------------------|---|

Digital input functions

As per digital inputs 1 & 2 in the ordering code

Digital outputs

| | |
|--------------------------|--------------------------|
| Relay rating | 2A, 264Vac resistive |
| Triple logic output | 8mA, 12Vdc per channel |
| Digital output functions | As per the ordering code |

DC retransmission

| | |
|-----------------------|--|
| Range | Scaleable between 0-20mA and 0-10Vdc |
| Resolution | 1 part in 10,000 |
| Retransmission values | Process value, setpoint or error from setpoint |

Transmitter supply

| | |
|--------|-------------|
| Rating | 20mA, 24Vdc |
|--------|-------------|

Strain gauge bridge supply

| | |
|-------------------|---------------------------------|
| Bridge voltage | Software selectable, 5 or 10Vdc |
| Bridge resistance | 300Ω to 10KΩ |

Alarms

| | |
|------------------|---|
| Number of alarms | Four |
| Alarm types | High, low, deviation high, deviation low, deviation band, rate of change in units/sec, rate of change in units/min. New alarm status. Sensor break alarm. |
| Selectable | On input 1, input 2 and main PV. |
| Alarm modes | Latching or non-latching. Blocking. Energised or de-energised in alarm |
| Alarm delay | OFF to 999.9 secs |

Communications

| | |
|--------------|--|
| Module types | RS232, 2-wire RS485 and 4-wire RS485 |
| Protocols | Modbus®, EI-Bisynch (ASCII) or Profibus-DP |

PDSIO

| | |
|-----------|--|
| Functions | Remote setpoint input from master controller |
|-----------|--|

General

| | |
|---------------------|--|
| Display colour | Red or green |
| Number of digits | Five with up to three decimal places |
| Supply | 100 to 240Vac -15%, +10% OR 24Vdc or ac -15%, +20%. |
| Power consumption | 15W max. |
| Operating ambient | 0 to 55°C and 5 to 95% RH non-condensing |
| Storage temperature | -10 to +70°C |
| Panel sealing | IP65 |
| Dimensions (mm) | 96W x 48H x 150D |
| Weight | 400g max |
| EMC standards | EN50081-2 & EN50082-2 generic standards for industrial environments |
| Safety standards | Meets EN61010, installation category II, pollution degree 2 |
| Atmospheres | Not suitable for use above 2000m or in explosive or corrosive atmospheres. |

Ordering Code Hardware

| Model Number | Function | Display Colour | Supply Voltage | Module 1 | Module 2 | Module 3 | Relay Output 1 | Comms Module | PDS Module | Manual |
|--------------|----------|----------------|----------------|----------|----------|----------|----------------|--------------|------------|--------|
| 2408i | | | | | | | | | | |

| Function | Module 1, 2 & 3 | Relay Output 1 | Comms Module |
|---|---|--|--|
| AL Indicator/Alarm unit AP Profibus Indicator/Alarm unit | XX None Relay (change over) R4 Fitted unconfigured OR Select alarm configuration from table A DC Retransmission D6 Fitted unconfigured First character V- PV retrans S- Setpoint retrans Z- Error retrans Second character -1 0-20mA -2 4-20mA -3 0-5V -4 1-5V -5 0-10V Dual relay (note 2) RR Fitted unconfigured | XX Not fitted RF Fitted unconfigured OR select alarm configuration from Table A Table A Alarm relay configuration (note 1) Non-latched alarm (PV1) FH High alarm FL Low alarm DB Dev. band alarm DL Dev. low alarm DH Dev. high alarm RA Rate-of-change alarm Latched alarm (PV1) HA High alarm LA Low alarm BD Dev. band alarm WD Dev. low alarm AD Dev. high alarm RT Rate-of-change alarm NW New alarm | XX Module not fitted RS232 A2 Fitted unconfigured AM Modbus protocol AE El-Bisynch protocol* RS485 (2-wire) Y2 Fitted unconfigured YM Modbus protocol YE El-Bisynch protocol* RS422 (4-wire) F2 Fitted unconfigured FM Modbus protocol FE El-Bisynch protocol* Profibus Module PB High speed RS485 * Not available with Profibus units |
| Display Colour GN Green display RD Red display | | | |
| Supply Voltage VH 85-264Vac VL 20-29Vac/dc | | | |
| | | | PDS Module XX Module not fitted M6 Fitted unconfigured RS Setpoint input |
| | | | Manual XXX No manual ENG English FRA French GER German NED Dutch SPA Spanish SWE Swedish ITA Italian |

Note 1:

By default, alarm 1 will be assigned to relay output 1 and alarms 2, 3 and 4 to modules 1, 2 and 3 respectively.

Note 2:

The allocation of alarms to the dual relay outputs is performed in configuration by the customer.

Note 3:

Triple contact or logic inputs can be configured, by the user, for any of the functions listed under Digital Inputs 1 and 2.

Note 4:

The triple logic outputs can be configured as alarm outputs or as telemetry outputs via digital communications.

Note 5:

By default, the transducer supply for input 1 will be installed in module position 2 and the transducer supply for input 2 in module position 1.

Example ordering code:

2408i - AL - GN - VH - RR - RR - XX - XX - YM - XX - ENG - K - 0 - 1000 - C - AC - KL
 2408i, Indicating alarm unit, green display, 85 to 264Vac, Dual relay, Dual relay, RS485, Modbus® comms, English manual, Type K thermocouple, 0 to 1000°C, Alarm acknowledge, Keylock

Configuration

| Configuration of Main Input | | | | | Configuration of 2nd Analogue input (requires D5 in module 3) | | | | |
|-----------------------------|--------------|--------------|---------------|---------|---|-----------------|--------------|-------------|-----------------------|
| Sensor Input | Setpoint Min | Setpoint Max | Display Units | Options | Digital Input 1 | Digital Input 2 | 2nd DC Input | PV Function | 2nd Input Display Min |
| | note 6 | note 6 | | | | | note 7 | | note 8 |

| Sensor Input & 2nd DC Input | Setpoint Min | Setpoint Max | Display Units | PV Function |
|--|---|---|---|---|
| Standard Sensor Inputs J J Thermocouple K K Thermocouple T T Thermocouple L L Thermocouple N N Thermocouple-Nicrosil/Nisil R R Thermocouple-Pt/Pt13%Rh S S Thermocouple-Pt/Pt10%Rh B B Thermocouple-Pt/Pt30%Rh -6%Rh P Platinel II Thermocouple Z RTD/PT100 DIN 43760 Factory Downloaded Input C C Thermocouple - W5%Re/W26%Re (Hoskins) D D Thermocouple - W3%Re/W25%Re E E Thermocouple 1 Ni/Ni18%Mo Thermocouple 2 Pt20%Rh/Pt40%Rh Thermocouple 3 W/W26%Re (Engelhard) Thermocouple 4 W/W26%Re (Hoskins) Thermocouple 5 W5%Re/W26%Re (Engelhard) Thermocouple 6 W5%Re/W26%Re (Bucose) Thermocouple 7 Pt10%Rh/Pt40%Rh Thermocouple 8 Exergen K80 I.R. pyrometer Process Inputs (Scaled to setpoint min and max) F -100 to +100mV linear Y 0 to 20mA linear (note 9) A 4 to 20mA linear (note 9) W 0 to 5Vdc linear G 1 to 5Vdc linear V 0 to 10Vdc linear | Min -210 -200 -200 -200 -250 -50 -50 0 0 -200 Min 0 0 -270 0 0 0 10 0 200 -45 Min -9999 -9999 -9999 -9999 -9999 | Max 1200 1372 400 900 1300 1768 1768 1820 1369 850 Max 2319 2399 1000 1399 1870 2000 2010 2300 2000 1800 650 Max 99999 99999 99999 99999 99999 | C Celsius F Fahrenheit K Kelvin X Blank Options XX Standard config. MP Melt pressure SG Strain gauge CL Custom linearisation Digital Inputs 1 & 2 XX Disabled (telemetry only) AC Alarm acknowledge KL Keylock SR Remote setpoint select PV Select process value I/P 2 J1 Initial tare correction on strain gauge input 1 J2 Initial tare correction on strain gauge input 2 J3 Automatic zero and span calibration for strain gauge, input 1 J4 Automatic zero and span calibration for strain gauge, input 2 | XX No function. PV = main input LO PV = the lowest of input 1 and input 2 HI PV = the highest of input 1 and input 2 FN PV derived from input 1 and 2 RS Remote setpoint |

Note 6:

Setpoint min and max: Include the decimal points required in the displayed value; up to one for temperature inputs, up to two for process inputs.

Note 7:

Select the code required from the Sensor Input table.

Note 8:

These two fields are used to scale the 2nd DC Input if it is a linear process input, otherwise it should be left blank.

Note 9:

For mA inputs, a 1% 2.49ohm current sense resistor is supplied as standard. If greater accuracy is required a 0.1% resistor can be ordered as part number: SUB2K/249R.1

Martech Controls
 2000 Teall Avenue
 Syracuse, NY13026
 Tel: (315) 876-9120
 www.martechcontrols.com
 sales@martechcontrols.com

